

biosmart gmbh weihergasse 11
 ch-3005 bern switzerland
 telefon: ++41 (0)31 318 28 08
 telefax: ++41 (0)31 318 28 09
 e-mail: mail@biosmart.ch
 www.biosmart.ch
 post-conto: 46-323024-2
 mwst-nr: 427 357
 accredited acc. ISO /1IEC 17025, STS 261




biosmart
 molecular analytical laboratories

Qualitycontrol:
Allin 2.0 Lot No. 180901

Mastermix: 180901

Pos. Control: 120900
int. Control Lectin: 130901

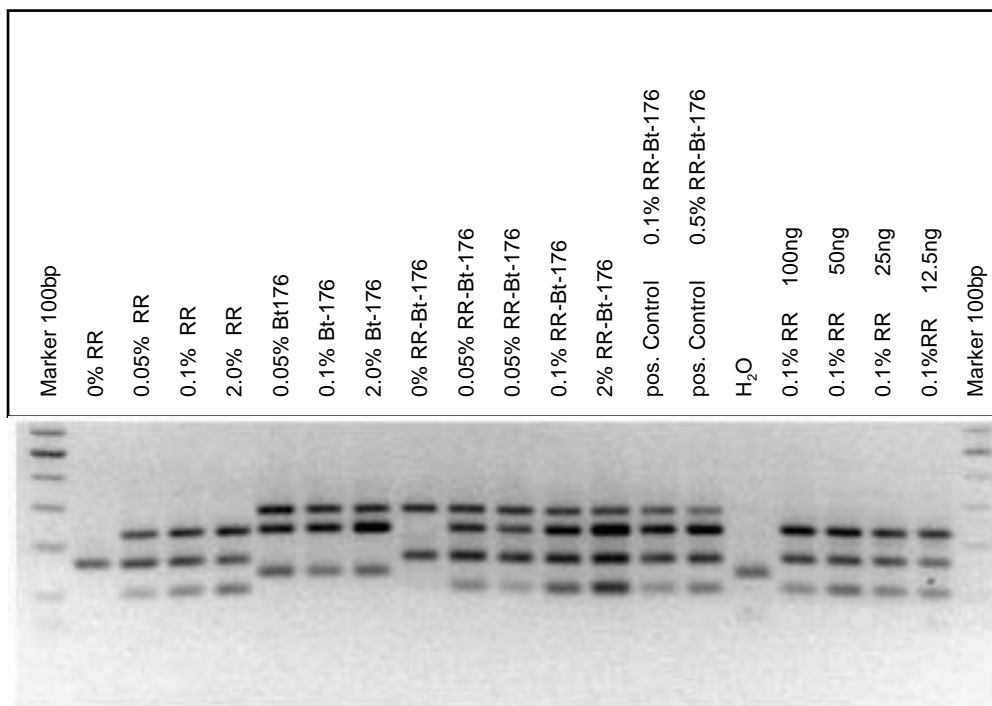

PCR product

Maize
35S-promoter

Soya
Internal Control
Nos

RR Roundup-Ready Soya
 Bt-176 Maximizer Maize

PCR product length:			
Maize	Zein	278 bp	
GMO-Promoter	35S	227 bp	
Soya	Lectin	163 bp	
Internal Control	Lectin	132 bp	
GMO-Terminator	Nos	104 bp	

DNA was isolated from certified Fluka standards.